


Section

DO NOT SCALE

Notes

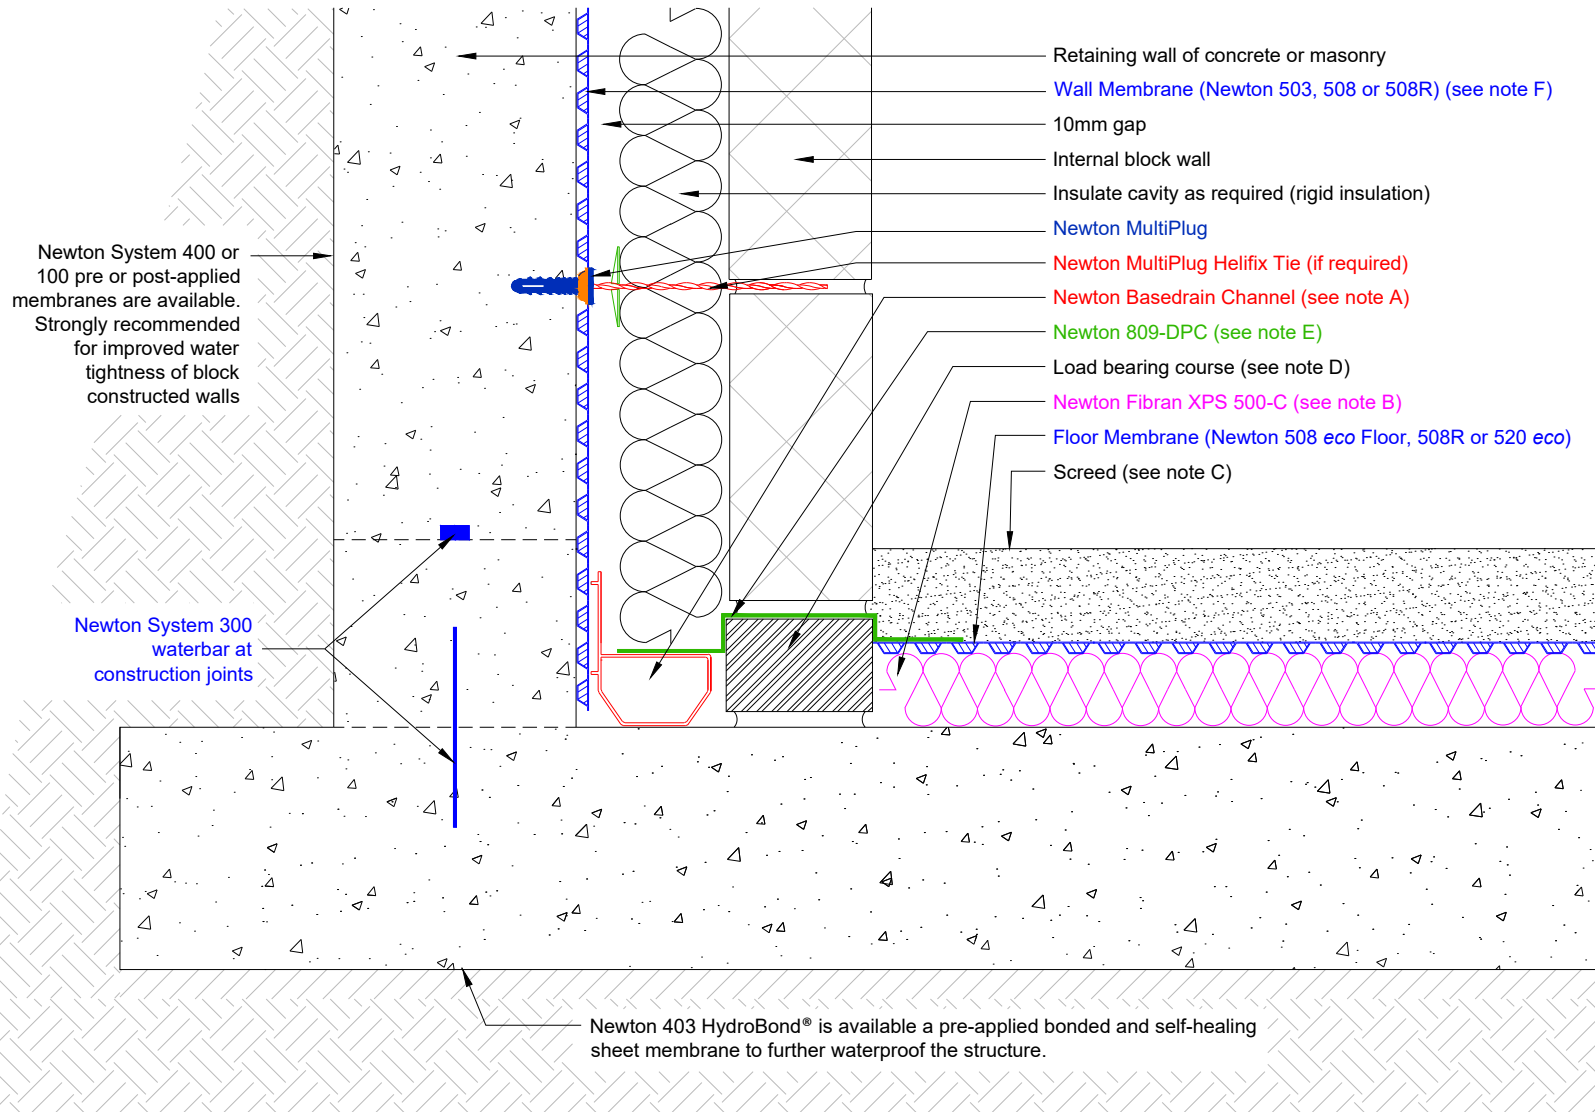

This detail assumes that the raft is in good condition - constructed to BS EN 1992 (Eurocode 2), and that the structure as a whole is of sufficient mass and quality to resist heads of water pressure as required by BS8102.

It is recommended that the concrete be treated with Newton 906 Lime Inhibitor to limit the leaching of free lime from the concrete.

All construction joints (day joints, shrinkage joints, movement joints etc) should be waterproofed with Newton System 300 waterbars to limit water ingress through joints in the structure.

A) Newton Basedrain should always be laid level and connected to the sump chamber or safe gravity drainage with at least two Drainage Connectors, see drawings CDM-P03 (Basedrain Layout & Parts) and CDM-P09 (Titan-Pro Pump System). Construction joints to the floor should be protected by Newton Floor drain, see drawing CDM-D01 (Construction joints protected by Newton Floor drain). For supporting walls detailing please see drawing CDM-D03.

B) Newton Fibran XPS 500-C is placed below the Newton flooring membrane as a fully drained supporting spacer. The maximum floor load is 16 Mpa (1.6 tonnes/m²). Newton Fibran XPS 500-C has a thermal conductivity of 0.035W/mk and as such will make a significant contribution to the U-value of the floor.

C) Screed to manufacturers recommendations or current British Standard.

D) The load bearing course will be either engineering brick or a load bearing insulation if a cold bridge is to be avoided. Newton Basedrain 'T-Pieces' should be placed through the load bearing course at 2m centres to allow water to pass to the Newton Basedrain.

E) i) Newton 809-DPC is taped to the Newton Floor membrane with Newton Waterseal Tape - not shown.
ii) Take the Newton 809-DPC across onto the top of the Newton Basedrain within the cavity as shown, tape to the Newton Basedrain with Newton Waterseal Tape - not shown (option).

F) Wall membrane and Condensation Strip should be trimmed to 40mm from slab to keep clear of the Basedrain holes.

To access further details and relevant technical information please call our Technical Team on 01732 360095 or refer to our [website](http://www.newtonwaterproofing.co.uk).

Newton CDM System

Internal cavity drain membrane system

Typical installation to structure with raft foundation

NOTE: This is a Newton waterproofing detail and copyright remains with John Newton & Co. Ltd. (trading as Newton Waterproofing Systems). Any specification/advice provided is only valid if used with products supplied by John Newton & Co. Ltd. For the design of the structure, please use a professional designer. We recommend that Newtons' waterproofing systems are installed by our NSBC registered contractors who can offer insurance backed guarantees and accept liability for both the design and installation of our systems. Please refer to product data sheets before installation of our products. Newton Waterproofing Systems reserve the right to update drawings and product literature at any time.

Scale Not to scale	Drawing Reference CDM-RA-03	Original Reference	Drawing Revision f
Date 27/05/2020	Designed by DGB	Drawn by CER	Checked by RC